

PT112/PT123/PT133 Series

3.33mV/V Output



Certification :

ISO9001-2015



Content

1.Introduction	_____
2.Application	_____
3.Product features	_____
4.Technical data	_____
5.Dimensions	_____
6.Electrical connection and debugging	_____
7.Ordering Guide	_____
8.Installation and Removal	_____
9.Sensors cleaning	_____
10.Transport and storage	_____

1. Introduction

PT112/PT123/PT133 melt pressure sensor is an accurate measuring equipment. The initial mV signal is compensated into standard 3.33 mV/V or 2.5 mV/V signal by using high quality core element. The measurement accuracy can be obtained by 0.5%.

2. Application

This series is designed for pipe extrusion, sheet extrusion, recycled plastics, recycled plastics and other extrusion processes with simple control.


3. Product Features

Accuracy 0.5%FS	Stainless steel sealing
80% internal calibration	Good stability and repeatability

4. Technical Data

Pressure Range	0~35bar;0~2000bar
Accuracy	±0.5%
Over load Pressure	1.5FSO
Bridge Resistance	350ΩWheatstone bridge
Power	6-12Vdc (10Vdc Standard)
Output Signal	3.33mV/V
Load Resistance (Ω)	> 10K
Calibration	80%FSO
Process Connection	M14×1.5、1/2-20UNF、M18×1.5
Insulation Resistance (50Vdc)	1000MΩ
Diaphragm Material	17-4PH、inconel718、C276
Diaphragm max temp	300C°
Film Material	TiAlN
E-connection	6-pin connector(Standard), 8-pin connector
Electrical Environment temp	-20C° ~ 85C°
Thermocouple	J Type,E Type,K Type,pt100
Protection degree	IP65
Installation torque	< 30Nm
Filling Material	Mercury filling

5. Dimensions

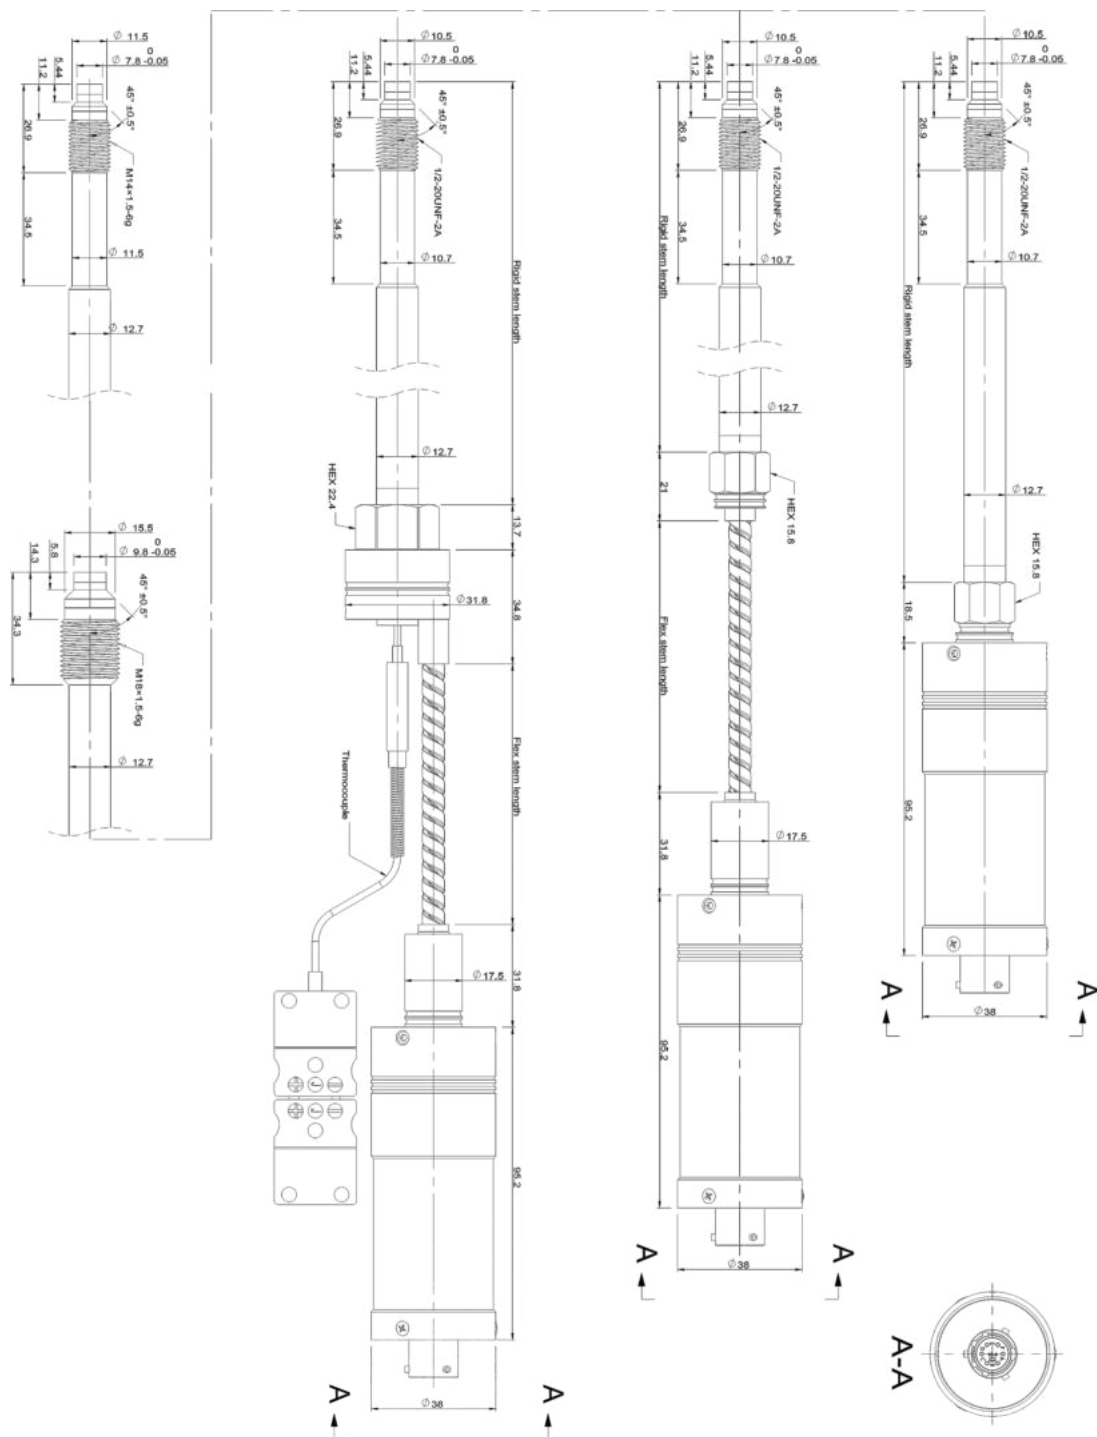


6. Electrical connection & Debugging


After the pressure sensor has been installed on the pipeline, the electrical connection must be carried out in accordance with the connection the wiring diagram below.

PT112/PT123/PT133 pressure sensor internal compensation has 80% calibration function, the calibration process must be pipeline heating and pressure is zero. Connect the calibration line to the negative pole of the excitation power supply (see wiring diagram), and the pressure sensor will provide a signal of standard 80% measurement.

3.33mV/V (4-wire)

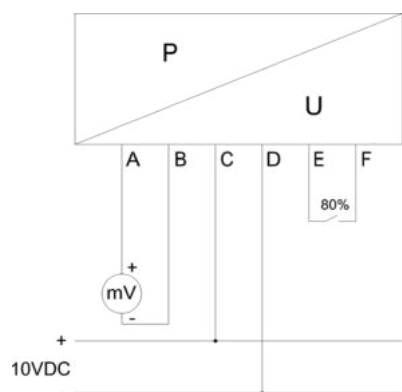


6-pin connector /PT02A-10-6P




PIN	Function	Wire Color
A	Signal +	Red
B	Signal -	Black
C	Power +	White
D	Power -	Green
E	80% +	Blue
F	80% -	Orange

3.33mV/V (4-wire)

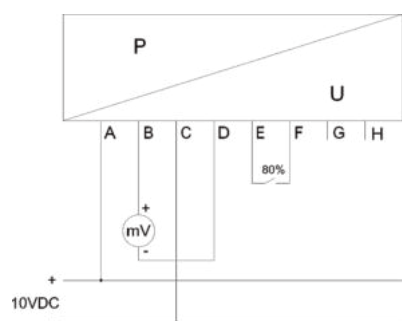


8-pin connector /PT02A-10-8P



PIN	Function	Wire Color
A	Power +	Red
B	Signal +	Black
C	Power -	White
D	Signal -	Green
E	80% +	Blue
F	80% -	Yellow
G		Grey
H		Brown

The cable shall be covered with shielding layer cable, each core wire is about 0.3 mm², temperature-resistance is not less than 105C°, each core wire connection column shall be insulated and protected by heat shrink tube isolation, shield wire shall be connected with plug-in metal, cable welding should be particularly careful, otherwise it may lead to signal transmission error or damage products. It is recommended to use Ziasiot welded special cable. For excess lines in the cable, each wire should be wrapped separately with insulating tape.

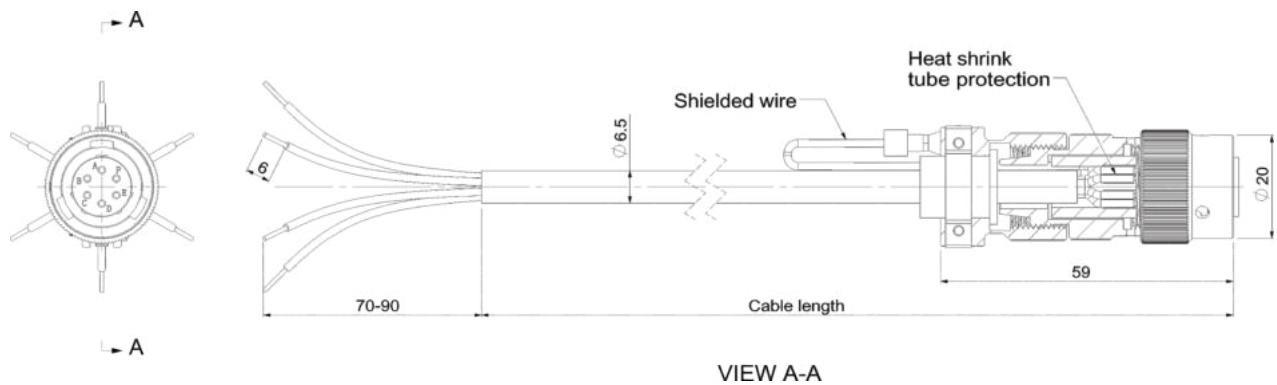

7. Ordering Guide

Serie No	PT	X	X	X	X	X	X	X	X	X	X
Product Type	Rigid Stem	112									
	Rigid+flexible stem	123									
	With thermocouple	133									
Pressure Range	10MPa 100bar 1500psi	1.5M									
	20MPa 200bar 3000psi	3M									
	35MPa 350bar 5000psi	5M									
	50MPa 500bar 7500psi	7.5M									
	70MPa 700bar 10000psi	10M									
	100MPa 1000bar 15000psi	15M									
	200MPa 2000bar 30000psi	30M									
Process Connction	1/2-20UNF		1/2								
	M14×1.5		M14								
	M18×1.5		M18								
Rigid stem Length	6" (152mm)			6							
	9" (229mm)			9							
	12.5" (318mm)			12							
	15" (381mm)			15							
	18" (460mm)			18							
Flexible stem Length	18" (460mm)			/18							
	24" (610mm)			/24							
	30" (760mm)			/30							
Output Signal	3.33mV/V							--			
	2.5mV/V							2.5MV			
E-connection	6-pin aviation Connector (PT02A-10-6P)							--			
	8-pin aviation Connector (PT02A-10-10P)							8P			
Thermocouple	J Type								J		
	K Type								K		
	E Type								E		
	Pt100								RTD1		
Accuracy	0.50%								--		
	0.25%								2A		
Diaphragm	17-4PH(Standard)									--	
	inconel718 (Anti-abrasive)									I7	
	C276 (Anti-corrosive)									C2	

8. Installation & Removal




Installation

When installing the pressure sensor, the sensor hole should be within the size requirement marked in following drawing and the assembly accuracy can be checked by testing bolts. Before installing the sensor, first clean the impurities in the hole and between the threads, then the thread of the sensor is coated with heat-resistant slurry, the screw teeth can be avoided.


The installation force is very important, the installation torque of the sensor can only act on the shaft (hexagon), do not apply any force to the head of the sensor. The housing should be kept away from high temperature areas.

1/2-20 UNF /M14×1.5= Maximum starting torque : 40Nm

M18 x 1.5 =Maximum starting torque : 50 Nm

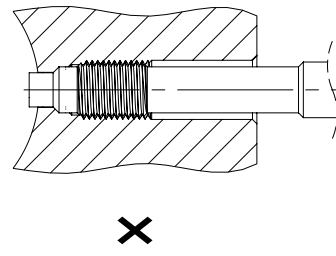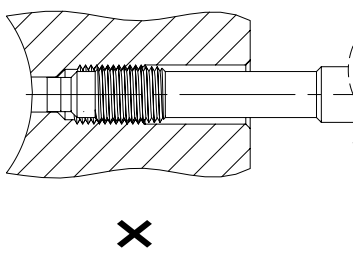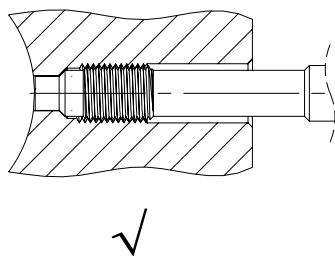

The removal of the pressure sensor must be done under heating conditions (plastic melting point). When removing the sensor, please note that the diaphragm has no contact pressure. the force to unload the sensor must be applied only on the shaft (hexagon) and do not apply any force to the sensor he

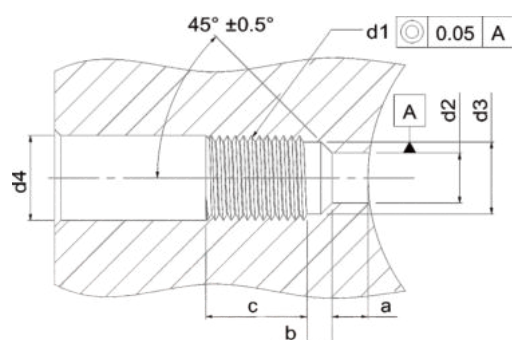

d1	M18×1.5	M14×1.5	1/2-20UNF-2A
d2	Ø9.9 ^{+0.1}	Ø7.9 ^{+0.1}	Ø7.9 ^{+0.1}
d3	Ø16.1 ^{+0.1}	Ø11.7 ^{+0.1}	Ø10.7 ^{+0.1}
d4	Ø20	Ø15	Ø14
a	6.1 ^{-0.1}	5.7 ^{-0.1}	5.7 ^{-0.1}
b	4 ^{-0.2}	3.2 ^{-0.2}	3.2 ^{-0.2}
c	25	19	19

9. Sensors cleaning

In order to clean the diaphragm, the sealing surface and thread of the transmitter must have the same temperature as the melting point of the plastic. The diaphragm and sealing surface can be cleaned with soft cloth, and the thread and rigid rod can be cleaned with steel brush or copper brush. (Do not touch diaphragm surface with steel brush)

10. Transport and storage

PT112/PT123/PT133 pressure sensor is usually packed separately. At the front thread of the rigid rod, the induction diaphragm is protected by a protective cap. This protective cap should be tightened at any time during storage, and only opened during installation.

Note: Mounting brackets, extension cables, connectors, cleaning kits, drill kits, dummy plug etc accessories, please contact with us.